

消 防 處
牌 照 及 審 批 總 區
香 港 九 龍 尖 沙 咀 東 康 莊 道 1 號 5 樓
消 防 總 部 大 廈



**FIRE SERVICES DEPARTMENT
LICENSING AND CERTIFICATION
COMMAND**

FIRE SERVICES HEADQUARTERS BUILDING,
5/F, No.1 Hong Chong Road,
Tsim Sha Tsui East, Kowloon,
Hong Kong.

本處檔號 OUR REF.: (51) in FP 206/1192
來函檔號 YOUR REF.: J-005/C/030
電子郵件 E-mail <lcpolic2@hkfsd.gov.hk>
圖文傳真 FAX: 852-2723 2197
電 話 TEL NO.: 2733 7557

26 August 2003

Bosch Security Systems Ltd.
12/F, Metropole Square
2 On Yiu Street, Shatin
N.T.

Dear Sirs,

Acceptance of Smoke Detectors

I refer to my interim reply of 7.7.2003 on the captioned subject.

The proposed use of the following detectors, which were certified by Underwriters Laboratories Inc. (UL), is considered acceptable to this Department:-

- | | |
|-----------------------------|--|
| Manufacturer | : Radionics, Div. of Detection Systems Inc.
(Basically listed for Detection Systems Inc.) |
| Type | : Smoke – Automatic Fire Detector for Duct Application
(Photoelectric or Ionization Type) |
| Models | : D340, D341 and D342 |
| Testing Standard | : UL268A |
| Supporting Documents | : (i) Test Report No. File S3019 Project 00NK42259 issued
by UL on 31 May 2001 and latest revised on
22 January 2003;
(ii) Multiple Listing Correlation Sheet ML File No. S4992
issued by UL on 1 April 1996 and latest revised on
22 April 2002 for Test Report File No. S3019 Vol.10. |
| Remark | : To be used in conjunction with model D285DH or DS286
smoke detectors. |

..../P.2

Manufacturer : Radionics, Div. of Detection Systems Inc.
(Basically listed for Detection Systems Inc.)

Type : Smoke – Automatic Fire Detector for Duct Application
(Photoelectric Type)

Model : D343

Testing Standard : UL268A


Supporting Document : (i) Test Report No. File S3019 Project 00NK42259 issued
by UL on 31 May 2001 and latest revised on
22 January 2003;
(ii) Multiple Listing Correlation Sheet ML File No. S4992
issued by UL on 1 April 1996 and latest revised on
22 April 2002 for Test Report File No. S3019 Vol.10.

Remark : To be used in conjunction with model D7050DH smoke
detector.

Please note that the above acceptance is subject to :-

- i) all conditions as stipulated in the above-mentioned test report being complied with;
- ii) the installation conforming to FSD Circular Letter No. 1/2002 Rules for Fire Detection and Alarm Systems for Buildings; and
- iii) the components used in the installation being compatible.

Yours faithfully,

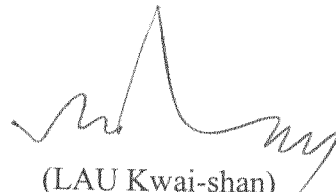

(LAU Kwai-shan)
for Director of Fire Services